


BULLETIN 2000-006-BU/PL


APRIL 19, 2007

ROOF DRAINAGE SYSTEM FOR DETACHED ACCESSORY BUILDINGS

The following information bulletin is provided as an alternate roof drainage system for detached accessory buildings added to developed S.F.D. properties (i.e. new garage, existing house) in lieu of normal requirements for a direct connection to the storm sewer

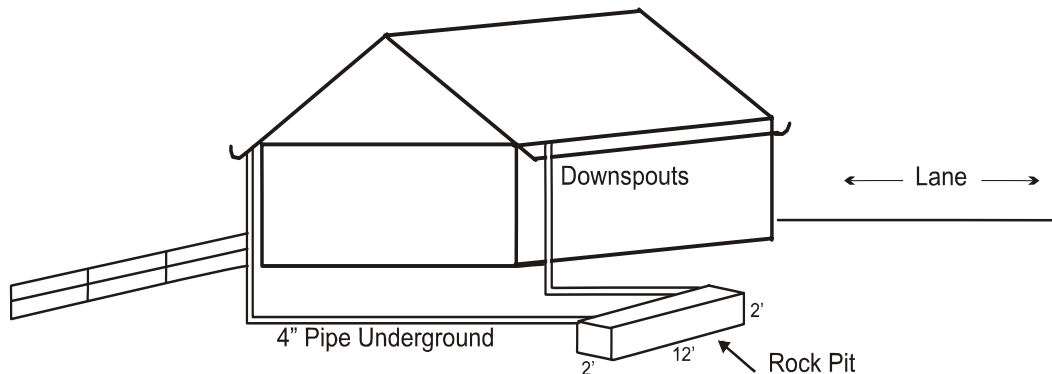

- Note:**
- a. Downspouts must terminate in a trench at least 2'x2'x12' and be filled with 3/4" drain rock
 - b. Ground must be left uncovered by concrete, asphalt, patios, etc., but may be covered by grass, garden, etc.
 - c. Trench to be located on side most remote from neighbouring property (Must be installed for framing inspection)

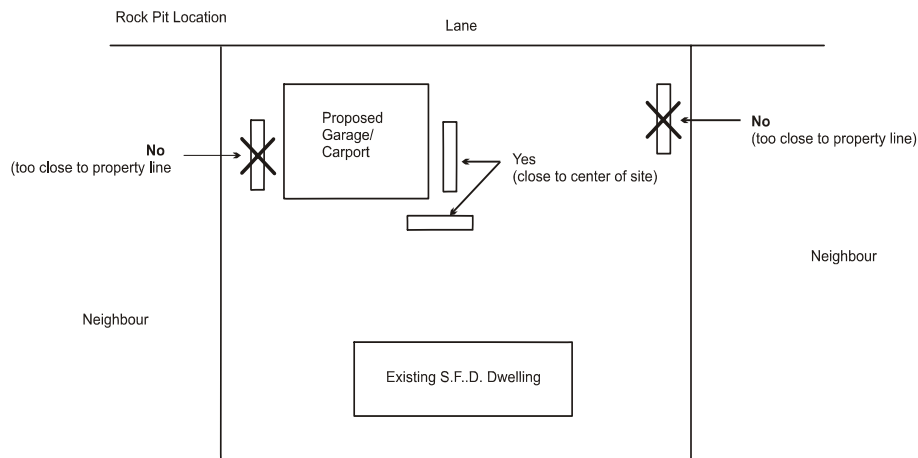

David Pope, Manager
Plumbing and Gas Inspection Branch

D. H. Jackson, P.Eng.
Chief Building Official