




Standards applicable to all non-potable water systems

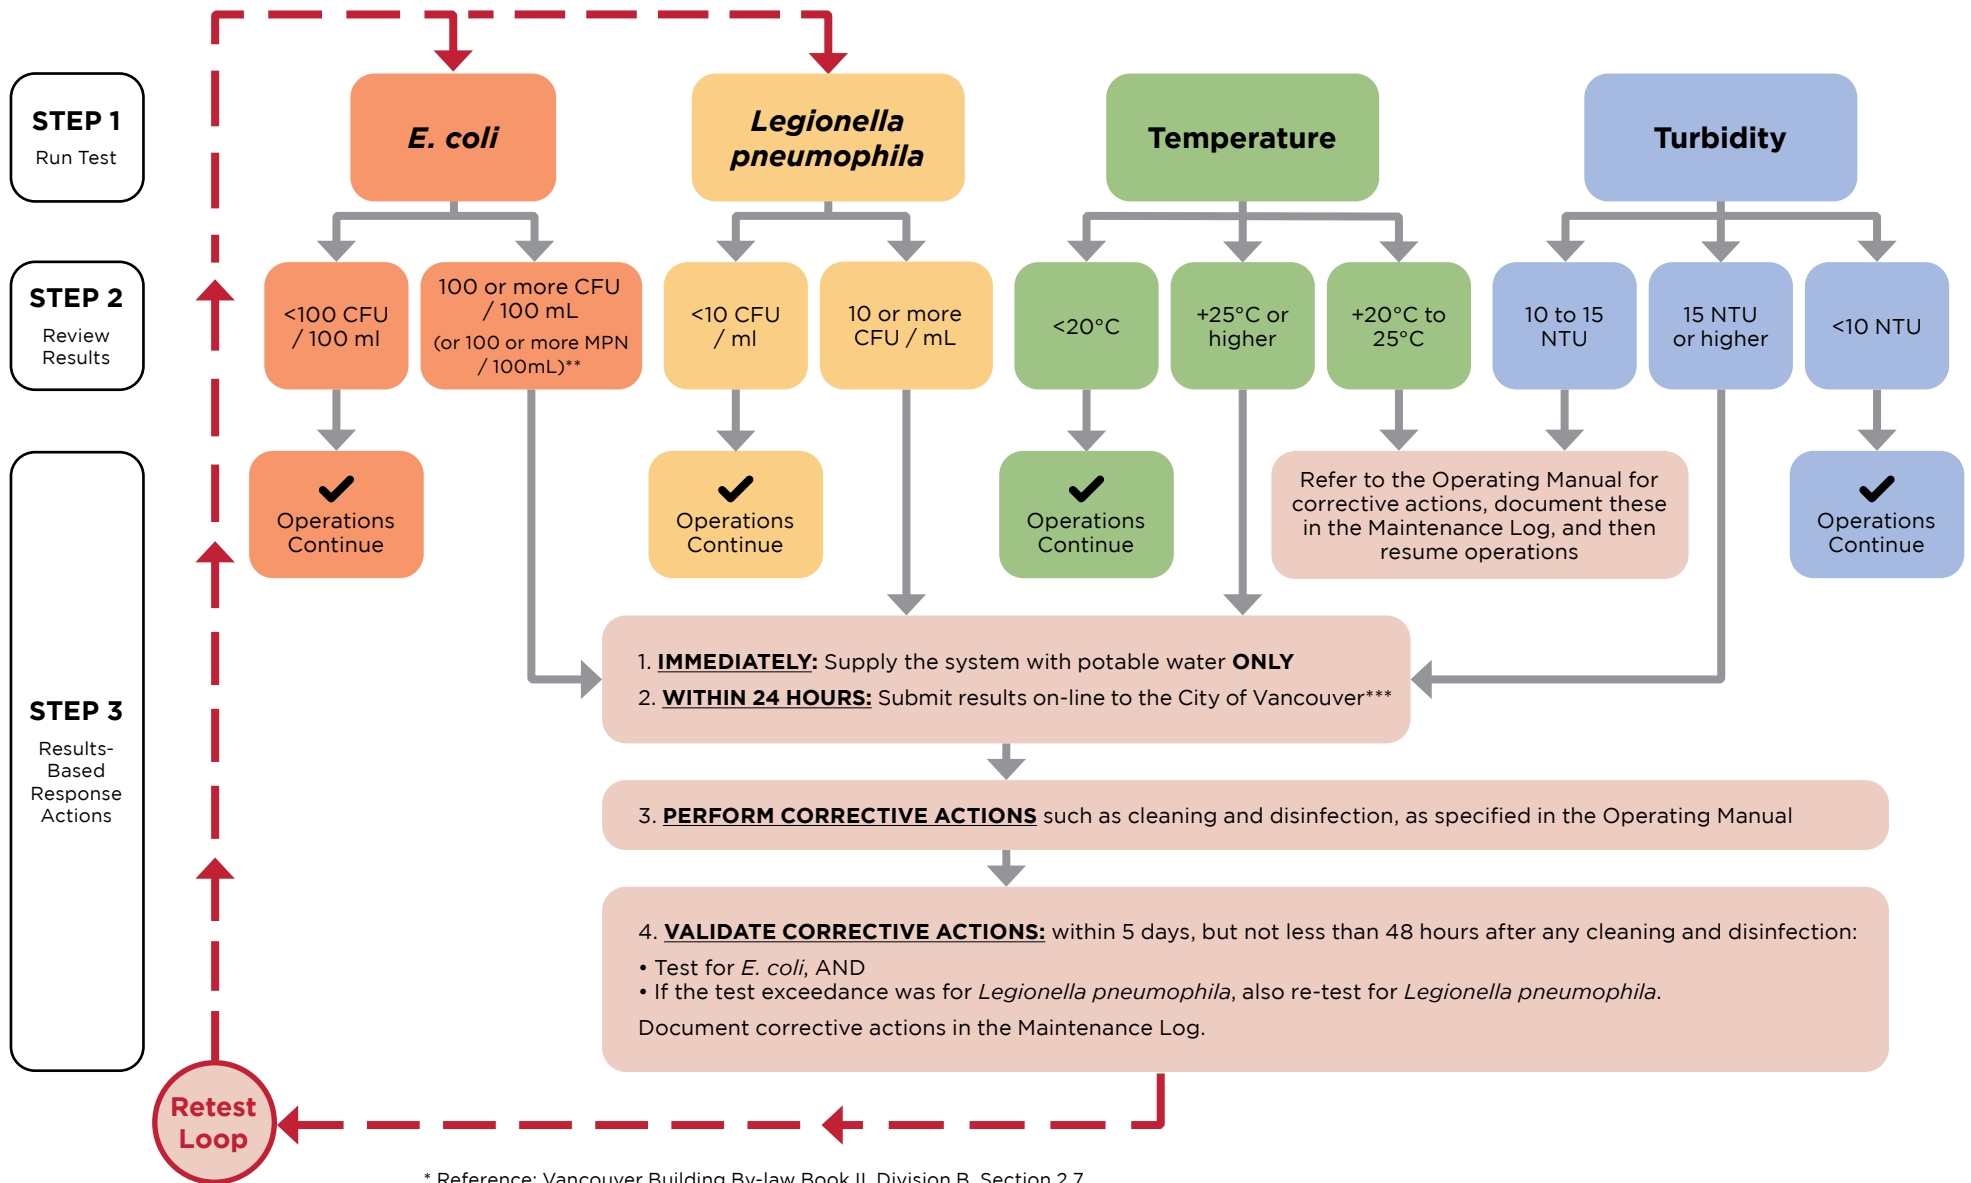


* Reference: Vancouver Building By-law Book II, Division B, Section 2.7.

** CFU means "Colony Forming Units" and MPN means "Most Probable Number". These are considered equivalent for *E. coli* testing.

*** Submitting the test result through the on-line portal constitutes notification of the City of Vancouver for the purposes of the Vancouver Building By-law notification requirement.



Standards applicable only to systems collecting rainwater from surfaces with vehicles

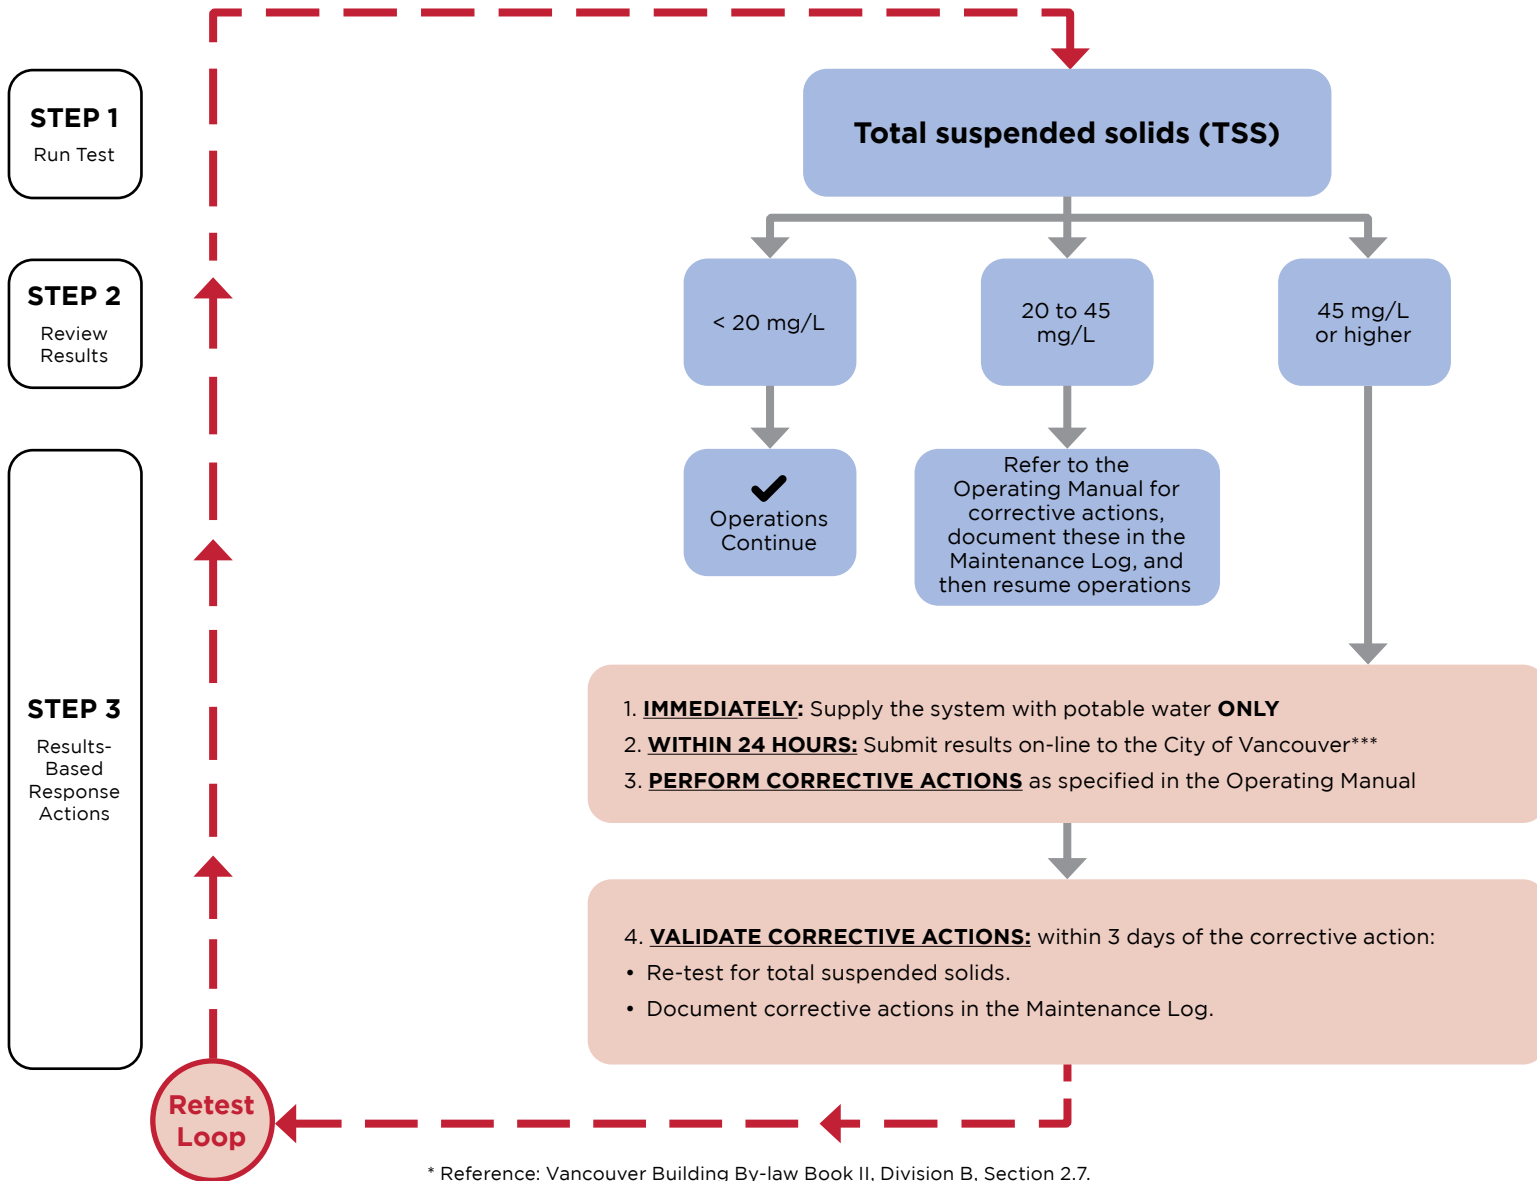


* Reference: Vancouver Building By-law Book II, Division B, Section 2.7.

*** Submitting the test result through the on-line portal constitutes notification of the City of Vancouver for the purposes of the Vancouver Building By-law notification requirement.



Standards applicable only to systems collecting rainwater from surfaces with vehicles

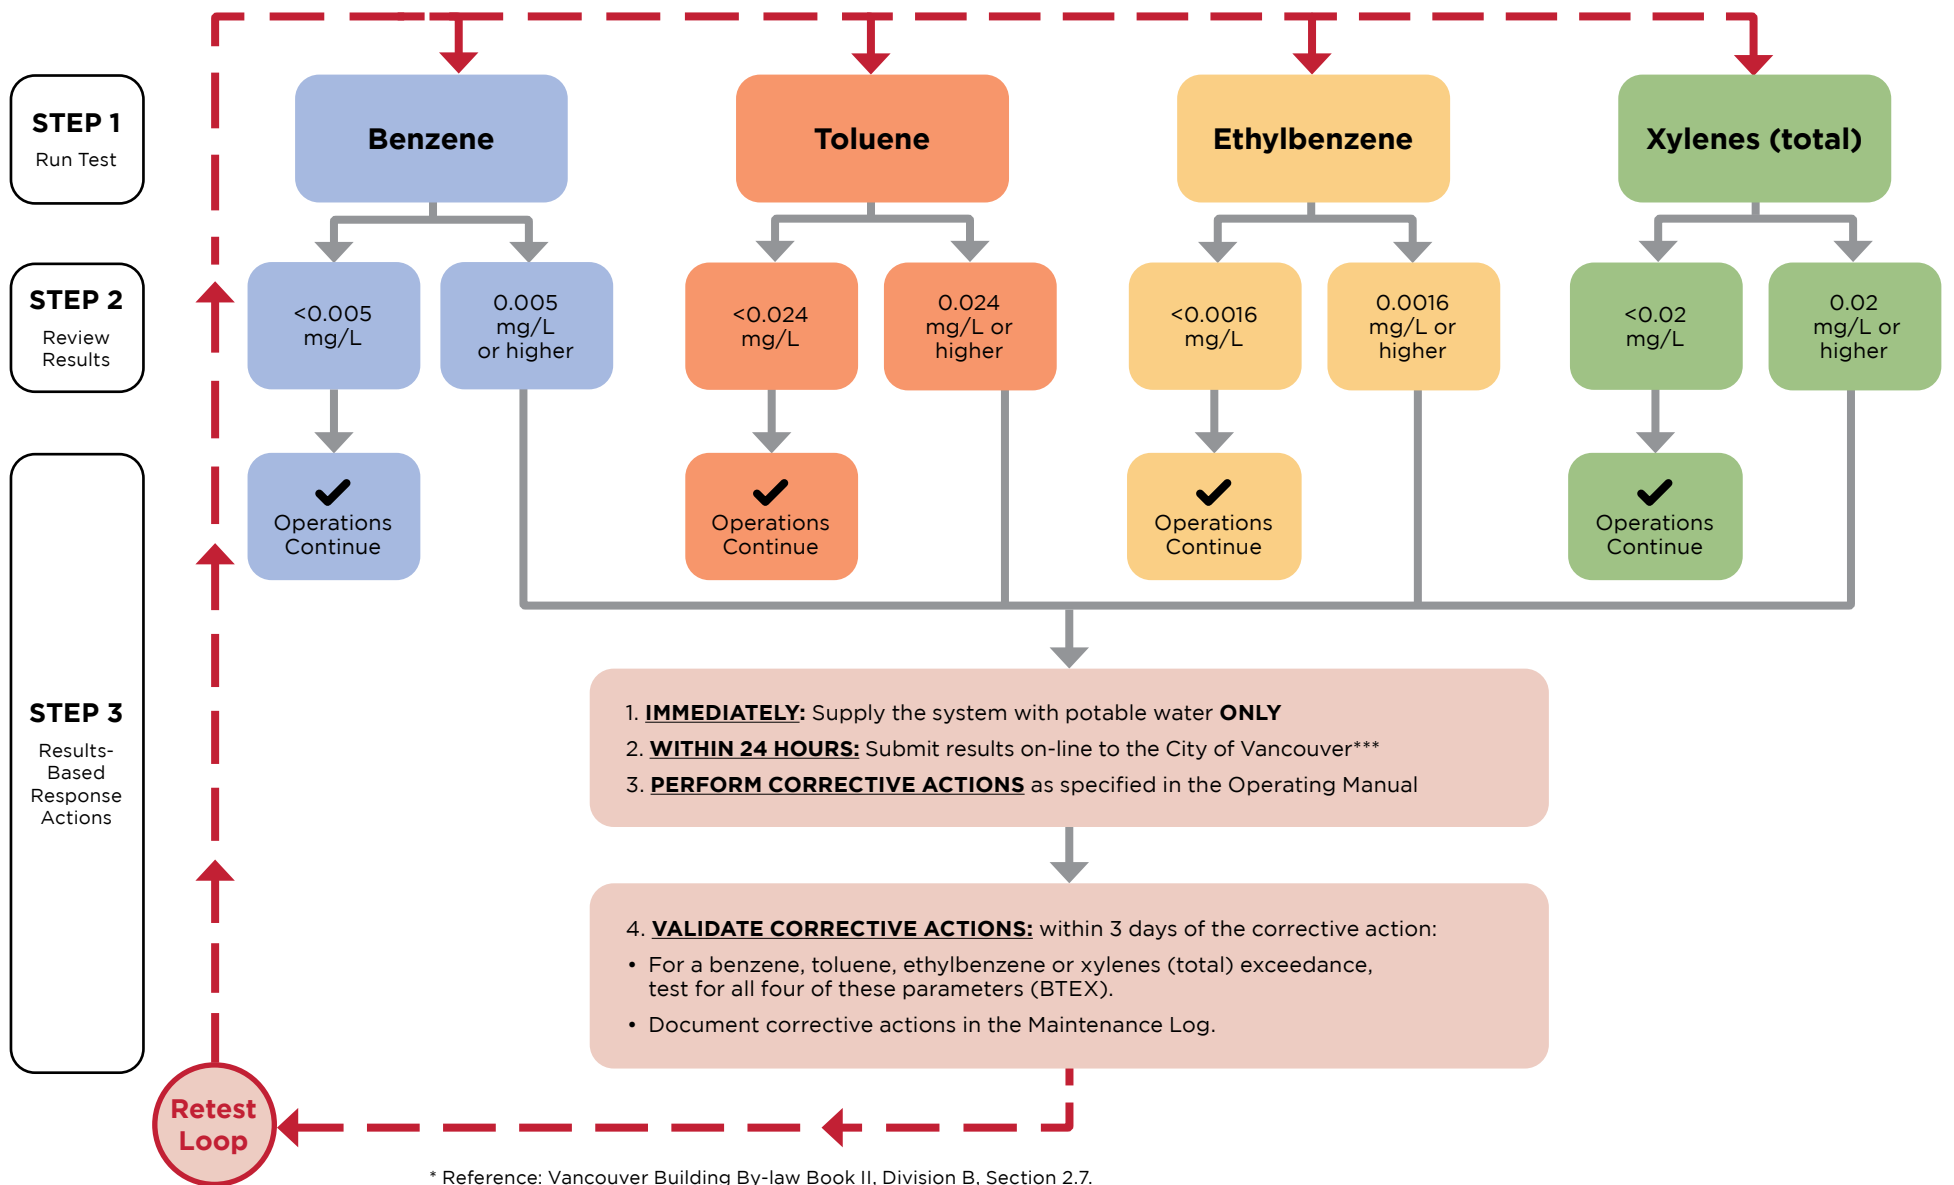

* Reference: Vancouver Building By-law Book II, Division B, Section 2.7.

*** Submitting the test result through the on-line portal constitutes notification of the City of Vancouver for the purposes of the Vancouver Building By-law notification requirement.