



GI INLETS AND OUTLETS DESIGN NOTES AND GUIDANCE

PURPOSE:

THE FOLLOWING DETAILS PROVIDE DESIGN ALTERNATIVES FOR CONVEYING WATER INTO AND OUT OF ROADSIDE GREEN INFRASTRUCTURE SYSTEMS. CAD FILES OF THESE DETAILS CAN BE PROVIDED UPON REQUEST TO THE GREEN INFRASTRUCTURE IMPLEMENTATION BRANCH (GREEN.INFRASTRUCTURE@VANCOUVER.CA). DESIGN REQUIREMENTS FOR INLETS AND OUTLETS IS PROVIDED IN THE DESIGN MANUAL.

DESIGNER NOTES & GUIDELINES:

1. ALL DIMENSIONS ARE IN METERS UNLESS OTHERWISE NOTED.
2. THE DESIGNER MUST SIZE INLETS AND OUTLETS PER DESIGN GUIDANCE INCLUDED IN THE GI DESIGN MANUAL.
3. GI SYSTEMS WITH INTERNAL CATCHBASINS CONNECTED TO MUNICIPAL SEWERS SHOULD BE DESIGNED TO ACCOMMODATE THE FULL DESIGN FLOW OF THE RECEIVING SEWER.
4. INLETS FOR GI SYSTEMS THAT ARE NOT DIRECTLY CONNECTED TO MUNICIPAL SEWER SYSTEMS SHOULD BE DESIGNED TO ACCOMMODATE THE PEAK FLOW OF THE 24hr 48mm GI DESIGN STORM.
5. ALL GI INLETS SHOULD BE DESIGNED WITH A SAFETY FACTOR OF 1.5.

STANDARD DRAWING DESCRIPTIONS		
2.1.	STRAIGHT STEEL INLET COVER	THE STRAIGHT STEEL CURB INLET COVER IS A STEEL COVER THAT PROVIDES A CONTINUOUS, FLUSH TOP-OF-CURB SURFACE OVER A CURB CUT. GI2.1 AND GI2.2 ARE OFTEN PAIRED WITH GI4.5.
2.2.	CURVED STEEL INLET COVER	THE CURVED STEEL CURB INLET IS A MODIFICATION OF THE STRAIGHT STEEL COVER INLET USED TO COVER CURB CUTS ON A ROADWAY BULGE.
2.3.	OPEN CURB CUT INLET	GI2.3. SHOWS THE CURB AND GUTTER GEOMETRY FOR A ROADSIDE CURB CUT INLET WITHOUT A STEEL COVER. THIS DETAIL SHOULD BE COMBINED WITH GI2.1 OR GI2.2 AND IS INTENDED FOR LOWER TRAFFIC AREAS OR AREAS WITHOUT STREET PARKING.
2.4.	COVERED CURB CUT INLET	GI2.4 IS A SIMILAR DESIGN TO GI2.3 BUT WITH A STEEL INLET COVER SUCH AS THOSE SHOWN IN GI2.1 AND GI2.2. THIS TYPE OF CURB INLET MAY ALSO BE PAIRED WITH A SEDIMENT CONTROL FEATURE SUCH AS THOSE SHOWN IN GI4.4 AND GI4.5.
2.5.	PRETREATMENT SEDIMENT PAD	PRETREATMENT SEDIMENT PADS ARE PLACED DOWNSTREAM OF A CURB CUT INLET AND ARE USED TO PREVENT EROSION OF BIORETENTION MEDIA AND REDUCE SEDIMENT ENTERING INTO GREEN INFRASTRUCTURE ASSETS. THEY MAY BE INSTALLED UPSTREAM OF BIORETENTION SYSTEMS OR TREE TRENCHES.
2.6.	PRETREATMENT SEDIMENT BASIN	PRETREATMENT SEDIMENT BASINS HAVE A SIMILAR FUNCTION AND ARE PLACED IN SIMILAR LOCATIONS TO SEDIMENT PADS, BUT THEY ARE INTENDED FOR LARGER CONTRIBUTING DRAINAGE AREAS AND HIGHER SEDIMENT LOADS.

DESIGNER CHECKLIST (MUST SPECIFY, AS APPLICABLE):

- INLET WIDTH AND LENGTH
- CROSS-SLOPE AND LONGITUDINAL SLOPE
- INLET CAPACITY DURING SEWERS DESIGN STORM (DEPTH OF FLOW AT DESIGN STORM PEAK FLOW)
- DOWNSTREAM PRETREATMENT COMPONENTS

LAYOUT REQUIREMENTS:

1. REFER TO THE CITY OF VANCOUVER ACCESSIBILITY STRATEGY, STANDARD DRAWINGS AND CONSTRUCTION SPECIFICATIONS FOR RIGHT-OF-WAY, PARKING SPACE, AND ACCESSIBLE PATH REQUIREMENTS.
2. LOCATE CURB CUTS AND GUTTER MODIFICATIONS TO AVOID CONFLICTS WITH ACCESSIBILITY REQUIREMENTS (E.G., LOCATE OUTSIDE OF CROSSWALKS).


REV.	REVISION DATE	APPROVED

**INLETS AND OUTLETS
INLETS AND OUTLETS DESIGN GUIDANCE**

ISSUE DATE: DECEMBER 2023
APPROVED BY: N. MEAD-FOX

PARTS LIST

ITEM	QTY	PART #	DESCRIPTION	MATERIAL	LENGTH	WIDTH	HEIGHT
①	1	STEEL CURB INLET	STEEL CURB INLET	12.7mm THK. 300W STEEL	500, 700, 1000	150	250mm
②	2	SUPPORT STRIP	SUPPORT STRIP	12.7mm THK. 300W STEEL	450 - 950	12.7	40-60mm

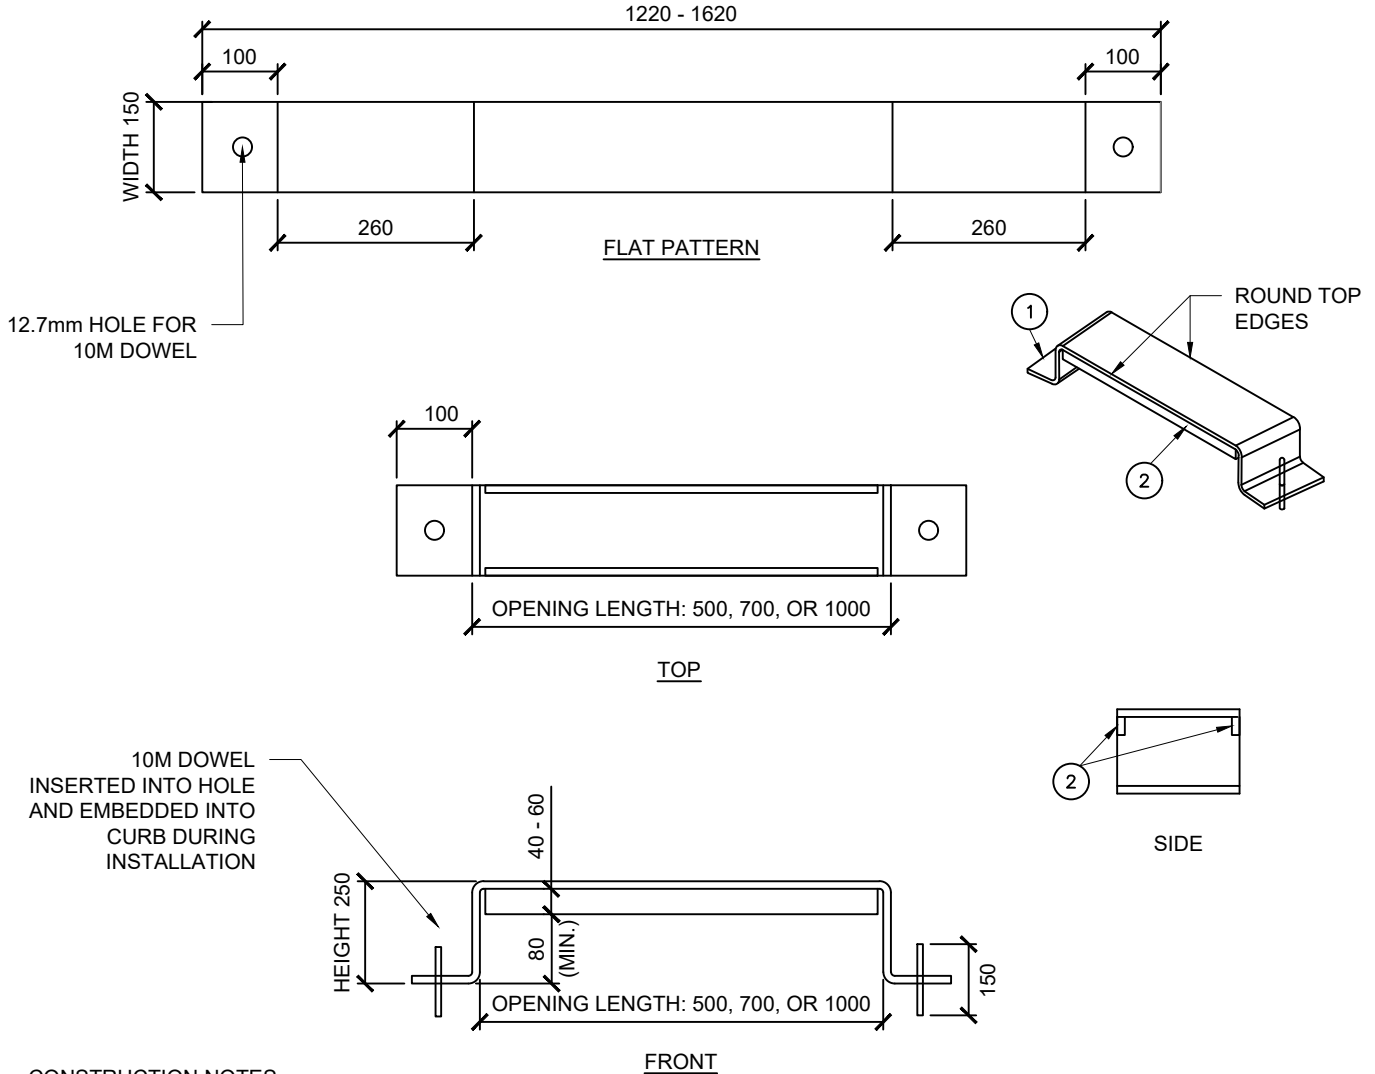

CONSTRUCTION NOTES:

1. ALL DIMENSIONS IN MILLIMETERS.
2. ENSURE NO SHARP EDGES.
3. STEEL INLET COVER TO BE 20mm GREATER THAN THE HEIGHT OF THE CURB FACE TO ACCOUNT FOR GUTTER PAN DEPRESSION.
4. DESIGN CRITERIA, APPLIED LOADING CONSTRAINTS, AND MAXIMUM VERTICAL POINT LOADING FOR VARIOUS COVER WIDTHS MAY BE PROVIDED UPON REQUEST.
5. PROVIDE STEEL IN CONFORMANCE WITH CITY OF VANCOUVER CONSTRUCTION SPECIFICATIONS.
6. STRUCTURAL MEMBER SIZING AND ORIENTATION OF ELEMENT TO BE CONFIRMED BY THE ENGINEER.
7. SUPPORT STRIP HEIGHT MAY BE INCREASED TO 80mm IN AREAS WITH A HIGH LIKELIHOOD OF VEHICLE LOADING


MAXIMUM DESIGN STORM PEAK FLOW (m ³ /s)	OPENING LENGTH (mm)	SUPPORT STRIP LENGTH (mm)	SUPPORT STRIP HEIGHT (mm)
0.006	500	451	40
0.008	700	651	60
0.010	1000	951	60

REV.	REVISION DATE	APPROVED

INLETS AND OUTLETS
STRAIGHT STEEL INLET COVER

ISSUE DATE: DECEMBER 2023
APPROVED BY: N. MEAD-FOX

PARTS LIST							
ITEM	QTY	PART #	DESCRIPTION	MATERIAL	LENGTH	WIDTH	HEIGHT
1	1	STEEL CURB INLET	STEEL CURB INLET	STEEL, MILD, 12.7mm	1137.7mm	150	250
2	1	SUPPORT STRIP	SUPPORT STRIP	STEEL, MILD, 12.7mm	650.9mm	12.7	40

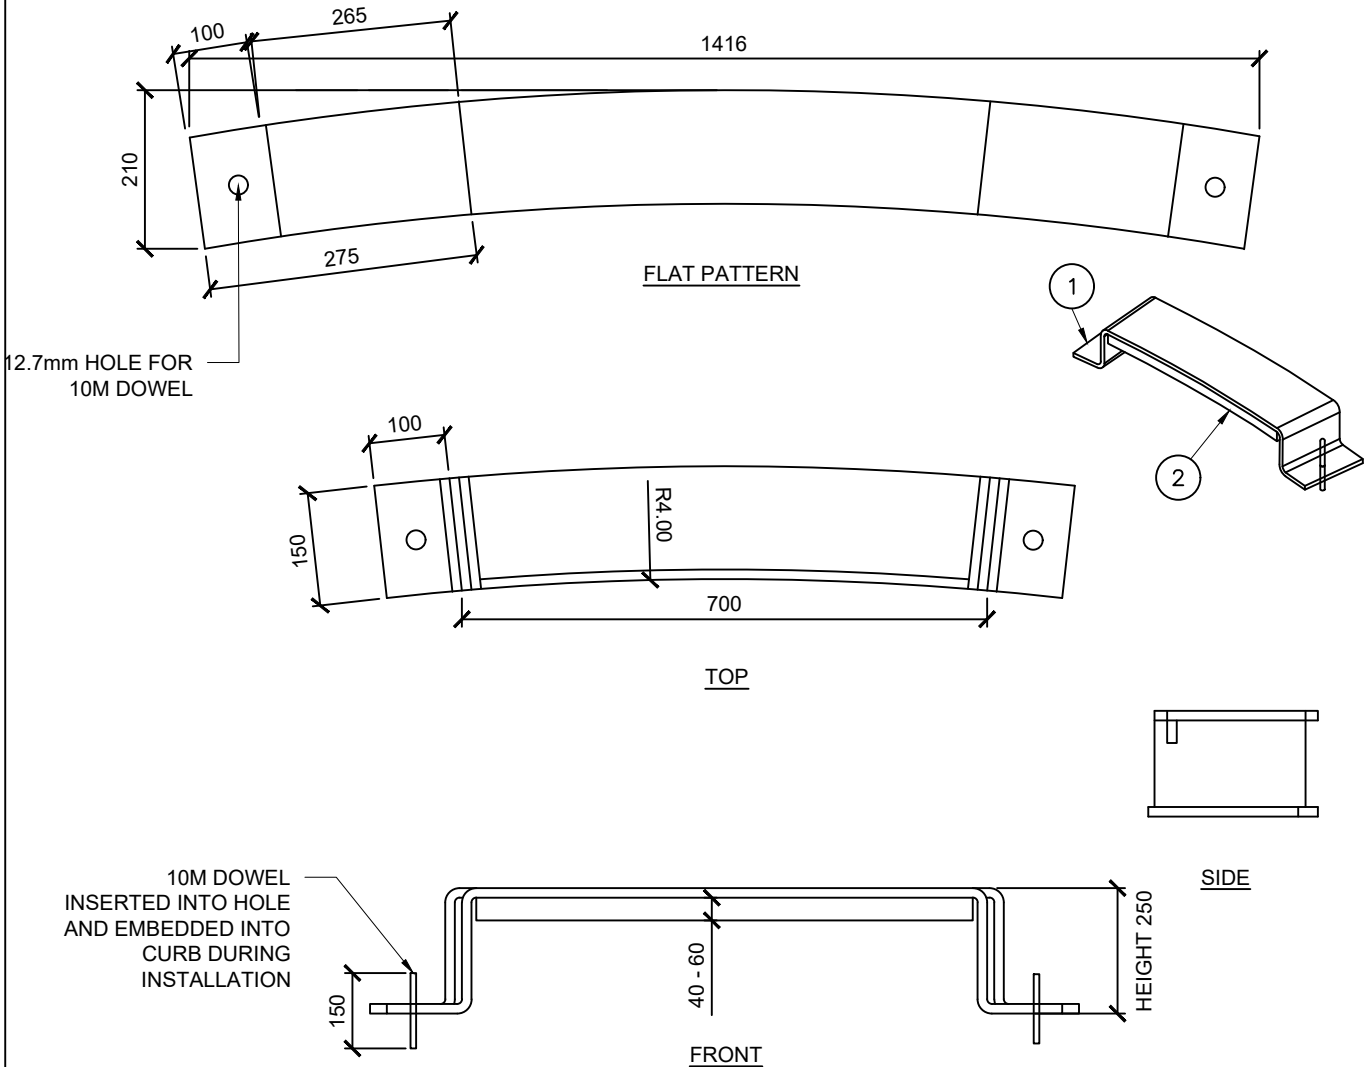


CONSTRUCTION NOTES

1. ALL DIMENSIONS IN MILLIMETERS.
2. ENSURE NO SHARP EDGES.
3. STEEL INLET COVER ARE TO BE 20mm GREATER THAN THE HEIGHT OF THE CURB FACE TO ACCOUNT FOR GUTTER PAN DEPRESSION.
4. DESIGN CRITERIA, APPLIED LOADING CONSTRAINTS, AND MAXIMUM VERTICAL POINT LOADING FOR VARIOUS COVER WIDTHS MAY BE PROVIDED UPON REQUEST.
5. PROVIDE STEEL IN CONFORMANCE WITH CITY OF VANCOUVER CONSTRUCTION SPECIFICATIONS.
6. STRUCTURAL MEMBER SIZING AND ORIENTATION OF ELEMENT TO BE CONFIRMED BY THE ENGINEER.
7. SUPPORT STRIP HEIGHT MAY BE INCREASED TO 80mm IN AREAS WITH A HIGH LIKELIHOOD OF VEHICLE LOADING


REV.	REVISION DATE	APPROVED

**INLETS AND OUTLETS
CURVED STEEL INLET COVER**

ISSUE DATE: DECEMBER 2023
APPROVED BY: N. MEAD-FOX

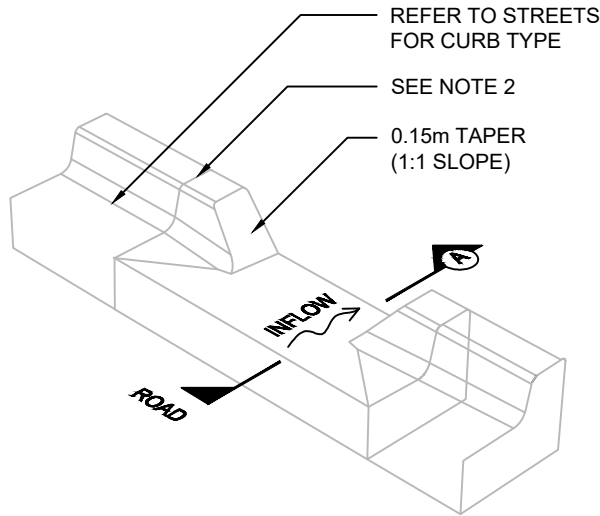


ISOMETRIC

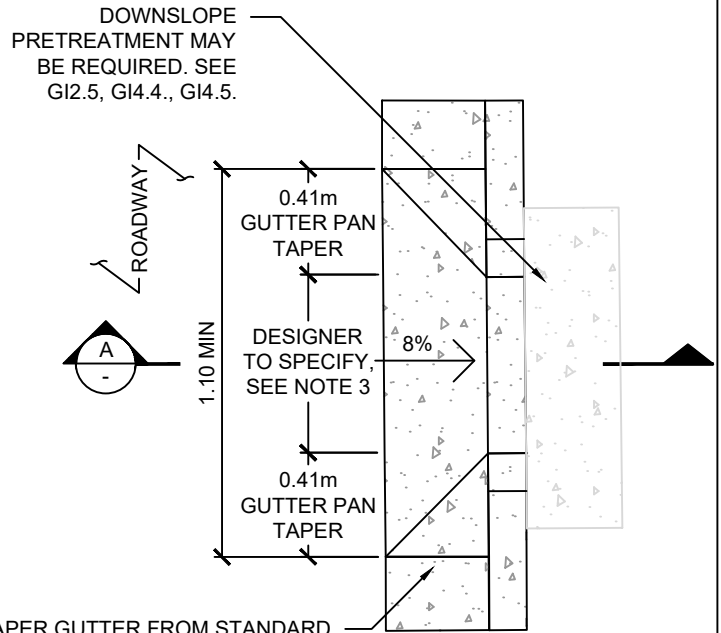

TAPER GUTTER FROM STANDARD GUTTER SLOPE TO DEPRESSED GUTTER SLOPE OF 8%.

PLAN

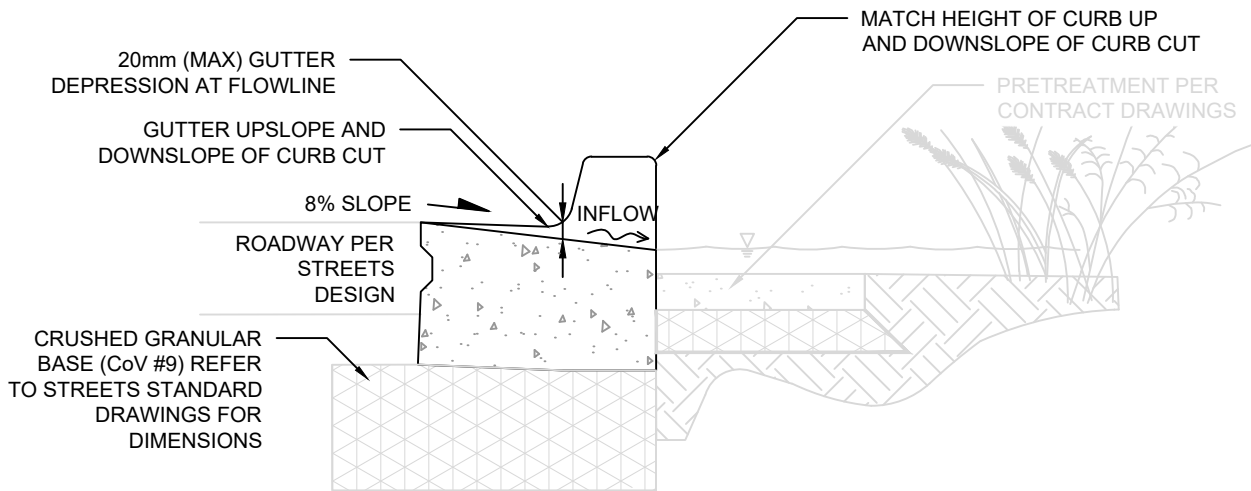

SECTION A


CONSTRUCTION NOTES

1. ALL MATERIAL AND WORKMANSHIP FOR CURB CUTS SHALL CONFORM TO CITY OF VANCOUVER STANDARD SPECIFICATIONS AND GUIDELINES
2. IF CURB CUT CANNOT BE INSTALLED AT CURB CONTROL JOINTS, BOND NEW CURB AND GUTTER TO EXISTING CURB AND GUTTER WITH EPOXY AND DOWEL CONNECTION
3. SEE DESIGN MANUAL FOR GUIDANCE ON DESIGNING INLET CURB CUT WIDTH.
4. CONCRETE TO BE POURED IN PLACE OVER STEEL COVER WING WALLS.
5. SEE GI2.5 FOR PRETREATMENT SEDIMENT PAD DETAILS


REV.	REVISION DATE	APPROVED

**INLETS AND OUTLETS
OPEN CURB CUT INLET**


ISSUE DATE: DECEMBER 2023
APPROVED BY: N. MEAD-FOX

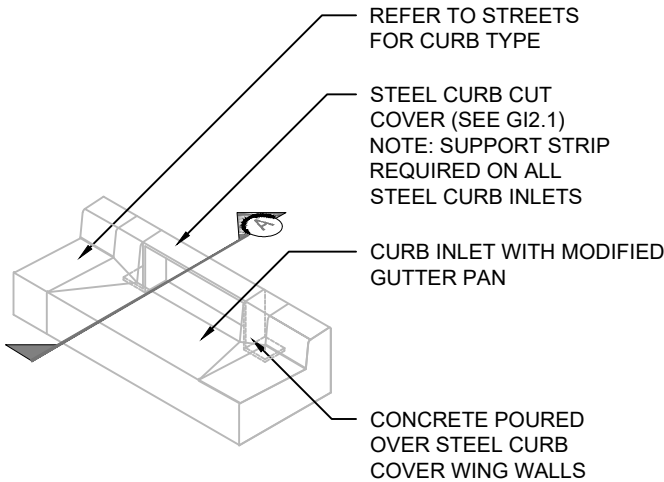

AXONOMETRIC

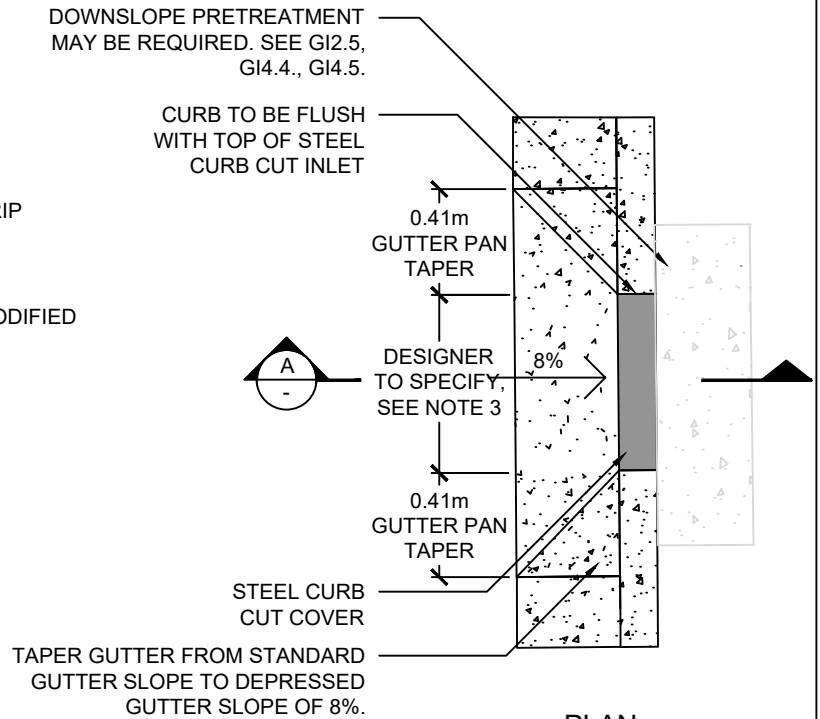

PLAN

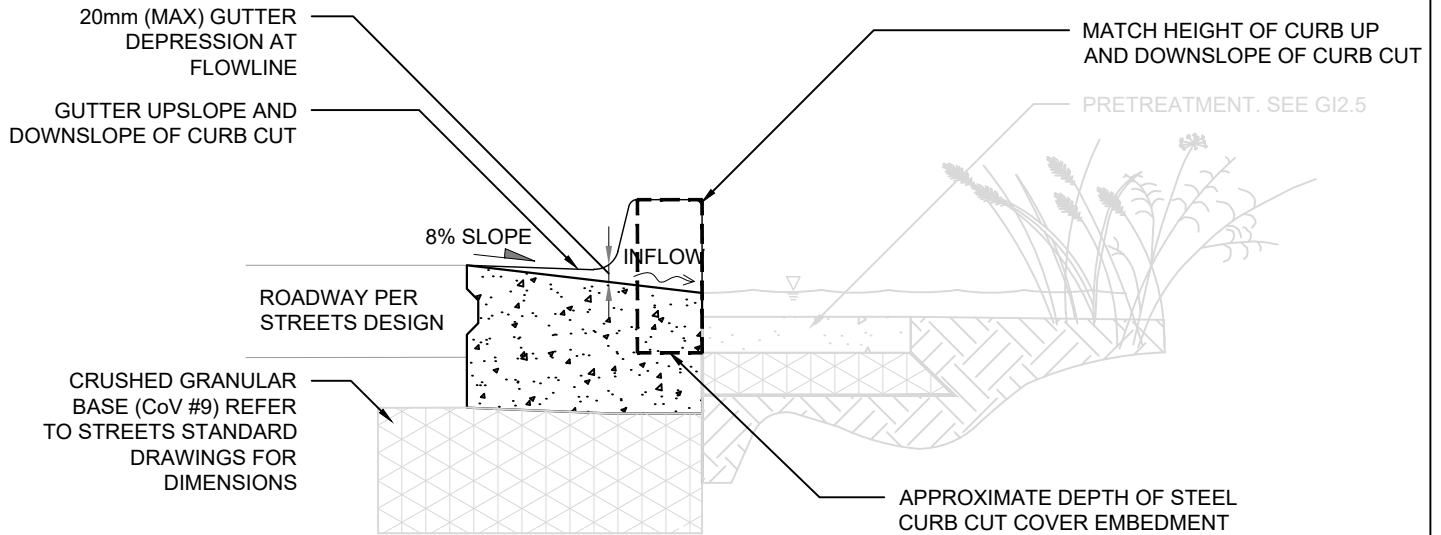

SECTION A


CONSTRUCTION NOTES

1. ALL MATERIAL AND WORKMANSHIP FOR CURB CUTS SHALL CONFORM TO CITY OF VANCOUVER STANDARD SPECIFICATIONS AND GUIDELINES
2. IF CURB CUT CANNOT BE INSTALLED AT CURB CONTROL JOINTS, BOND NEW CURB AND GUTTER TO EXISTING CURB AND GUTTER WITH EPOXY AND DOWEL CONNECTION
3. SEE DESIGN MANUAL FOR GUIDANCE ON DESIGNING INLET CURB CUT WIDTH.
4. CONCRETE TO BE POURED IN PLACE OVER STEEL COVER WING WALLS.
5. SEE GI2.5 FOR PRETREATMENT SEDIMENT PAD DETAILS


REV.	REVISION DATE	APPROVED

**INLETS AND OUTLETS
COVERED CURB CUT INLET**

ISSUE DATE: DECEMBER 2023
APPROVED BY: N. MEAD-FOX

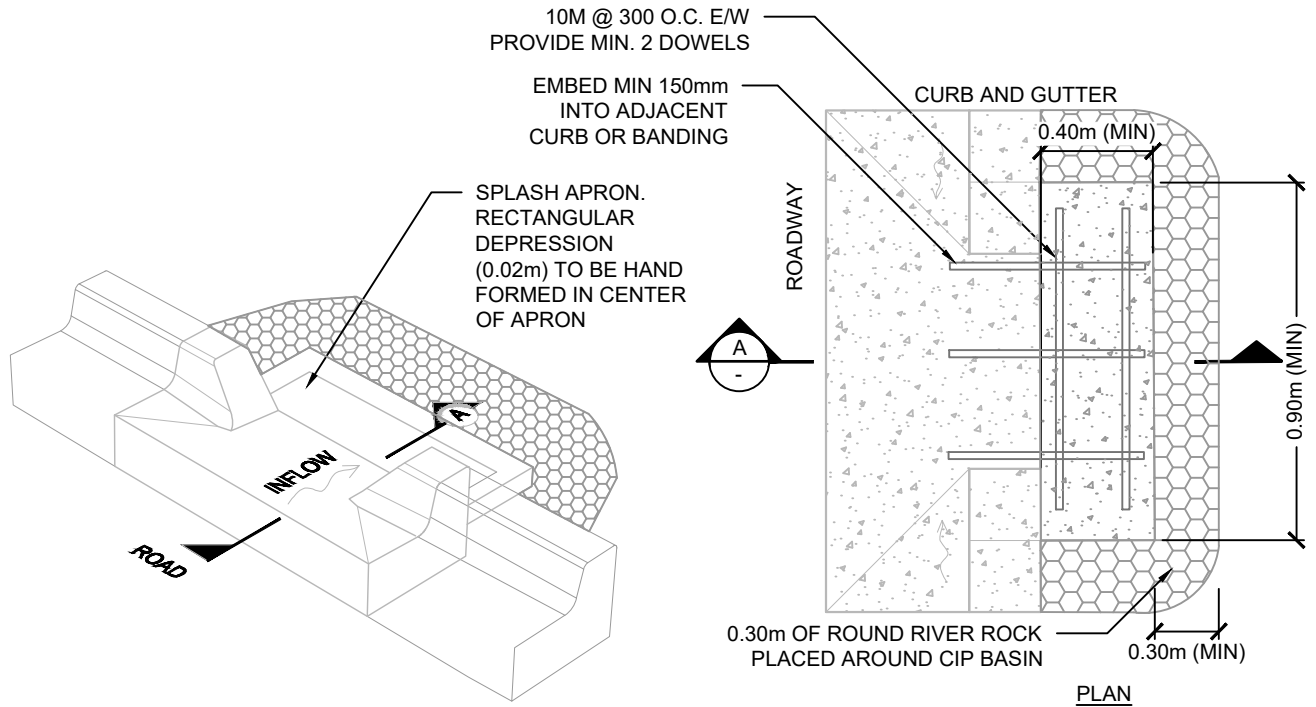

AXONOMETRIC

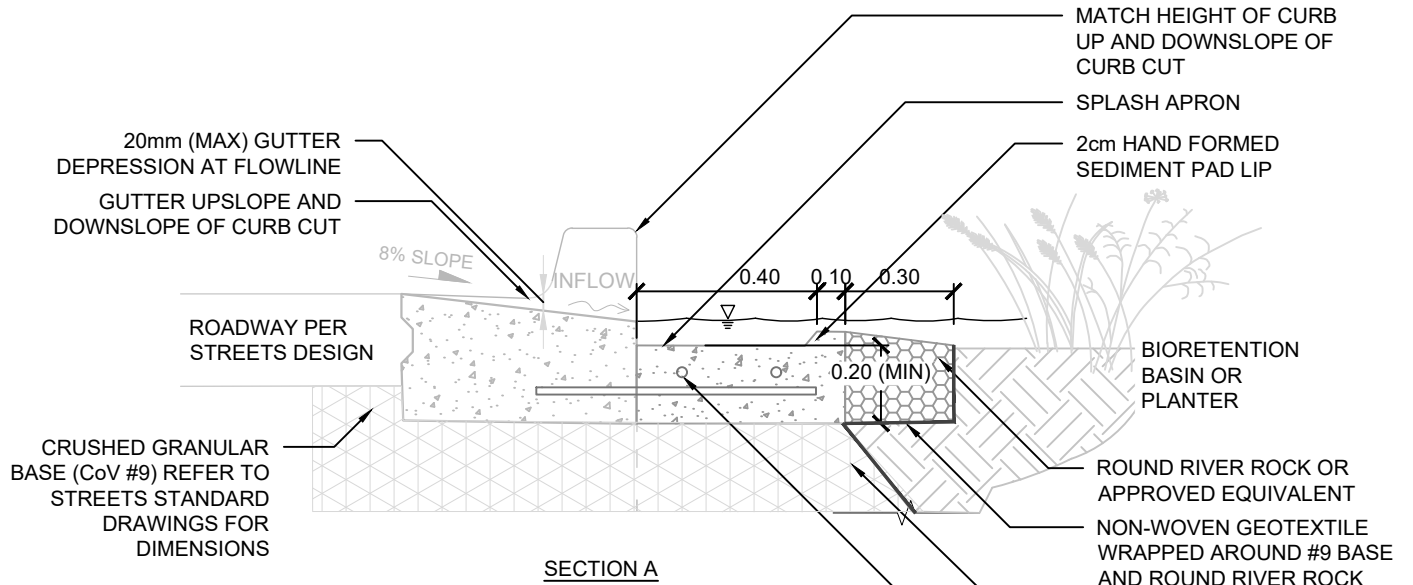


NOTES

- HAND PACK GROWING MEDIUM AND #9 BASE UNDER AND AROUND THE SEDIMENT PAD TO A DISTANCE OF 0.3m
- ROUND RIVER ROCK MAY BE REPLACED WITH ALTERNATIVE EROSION AND SEDIMENT CONTROL MEASURES SUCH AS COMPOST SOCKS.
- ALL MATERIAL AND WORKMANSHIP FOR CURB CUTS SHALL CONFORM TO CITY OF VANCOUVER STANDARD SPECIFICATIONS AND GUIDELINES
- IF CURB CUT CANNOT BE INSTALLED AT CURB CONTROL JOINTS, BOND NEW CURB AND GUTTER TO EXISTING CURB AND GUTTER WITH EPOXY AND DOWEL CONNECTION.
- INLET CURB CUT WIDTH SHALL BE 0.7m OR GREATER ON GUTTER SLOPES > 5%
- GI2.5. TO BE USED WHEN CONTRIBUTING DRAINAGE AREA IS LESS THAN 100 m². REFER TO GI2.6, GI4.4 AND GI4.5 FOR ALTERNATE PRETREATMENT OPTIONS.

REV.	REVISION DATE	APPROVED

INLETS AND OUTLETS
PRETREATMENT SEDIMENT PAD

ISSUE DATE: DECEMBER 2023
APPROVED BY: N. MEAD-FOX

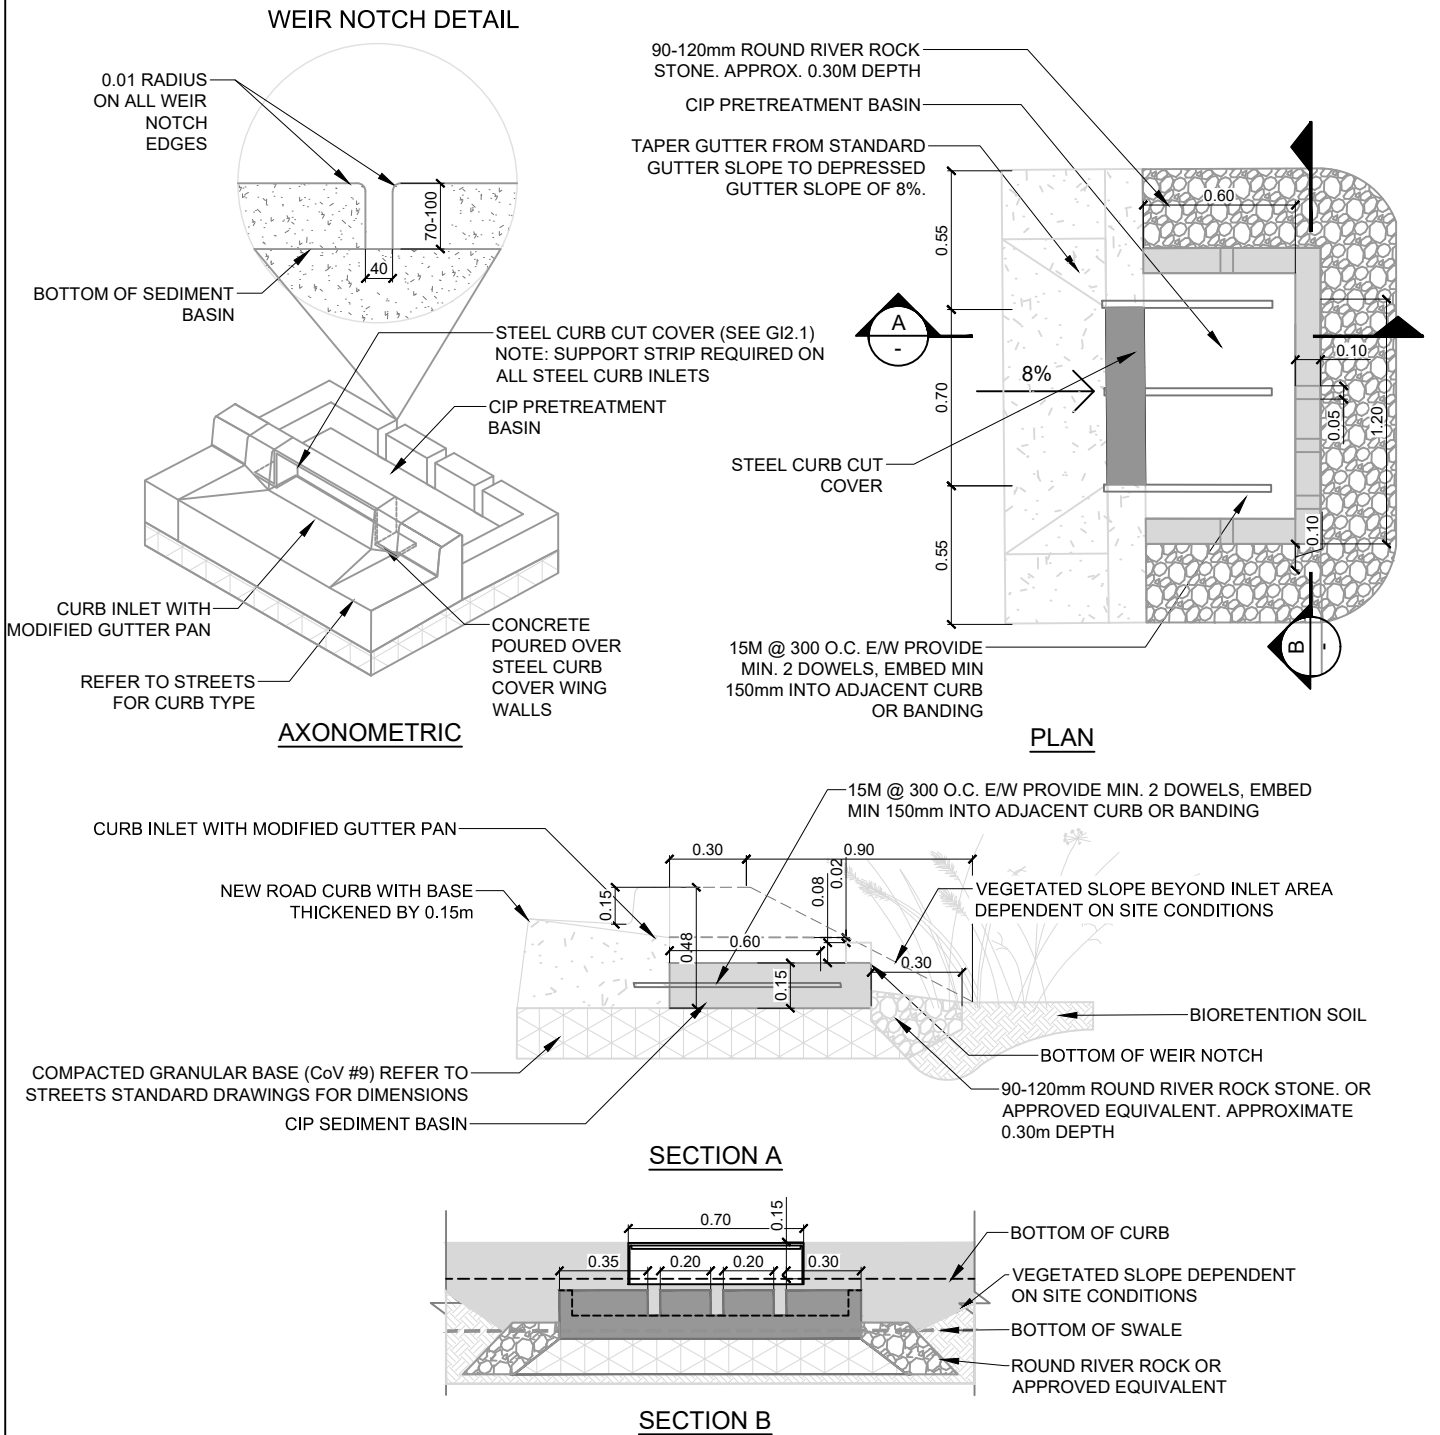

NOTES

- HAND PACK GROWING MEDIUM AND #9 BASE UNDER AND AROUND THE SEDIMENT PAD TO A DISTANCE OF 0.3m
- TOP OF SOIL/MULCH SHOULD BE AT MINIMUM 0.05 METERS BELOW THE WEIR WALL NOTCHES
- ROUND RIVER ROCK MAY BE REPLACED WITH ALTERNATIVE EROSION CONTROL MEASURES
- ALL MATERIAL AND WORKMANSHIP FOR CURB CUTS SHALL CONFORM TO CITY OF VANCOUVER STANDARD SPECIFICATIONS AND GUIDELINES
- IF CURB CUT CANNOT BE INSTALLED AT CURB CONTROL JOINTS, BOND NEW CURB AND GUTTER TO EXISTING CURB AND GUTTER WITH EPOXY AND DOWEL CONNECTION.
- INLET CURB CUT WIDTH SHALL BE 0.7m OR GREATER ON GUTTER SLOPES > 5%

REV.	REVISION DATE	APPROVED

**INLETS AND OUTLETS
PRETREATMENT SEDIMENT BASIN**

ISSUE DATE: DECEMBER 2023
APPROVED BY: N. MEAD-FOX